


**VARIOUS
TECHNOLOGIES
INCORPORATED**

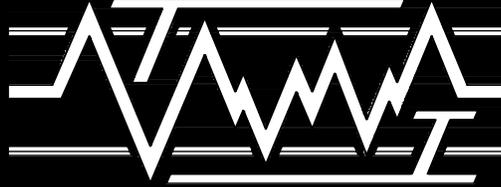


Komand-O-Lot™

SIMPLEX SINGLE CONTAINMENT PUMP STATION

SAMPLE SPECIFICATIONS

SERIES NUMBER PS-1

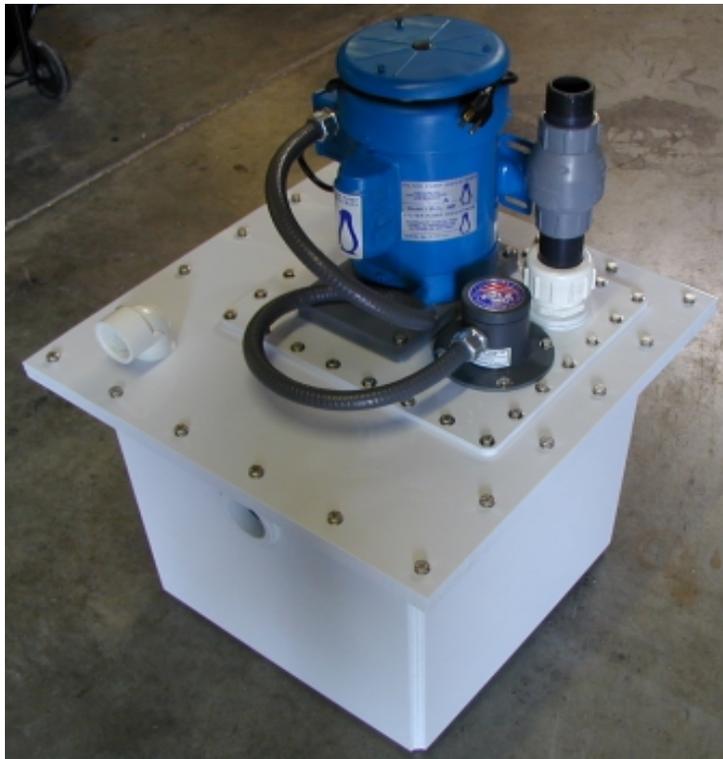

High Quality Sets Our Standards™

VARIOUS TECHNOLOGIES INCORPORATED
2720 AIELLO DRIVE , BUILDINGS C/D , SAN JOSE, CA 95111
TELEPHONE (408)972-4460 FAX (408)972-4125

SIMPLEX SINGLE CONTAINMENT PUMP STATION SAMPLE SPEC PS1VTI
WASTEWATER LIFT STATION - SECTION 1 -

PART 1 - GENERAL

1.01 DESCRIPTION

A. Furnish a complete, ready to install, factory tested, simplex single containment pump station as specified herein.

1.02 QUALITY ASSURANCE

A. The products under this section shall be supplied and manufactured by a single manufacturer who has been regularly engaged in the design and manufacture of pump stations, liquid level controls, and custom control panels for at least 5 years.

B. The pump station shall be cycle tested to insure error free operation. If the unit does not pass the factory test the manufacturer shall correct the defect and retest the pump station until operation testing is satisfactorily completed.

C. The manufacturer shall warranty the pump station for a period of 1 year.

1.03 SUBMITTALS

A. Shop drawings: Furnish shop drawings for review and final comments prior to manufacturing the pump station. The following data will be considered sufficient data to show that the pump station conforms to the specification:

1. Drawing of the pump station showing the inlet location, discharge location, and vent location.
2. Drawing showing pump station tank and overall dimensional data.
3. Liquid level controller data with set points.
4. Pump performance curves.
5. Factory warranty.

B. Manuals: Furnish 4 copies of bound manufacturer's installation and operation manuals with the finished pump station. The manuals are to include the following.

SIMPLEX SINGLE CONTAINMENT PUMP STATION SAMPLE SPEC PS1VTI
WASTEWATER LIFT STATION - SECTION 1 -

1. Operation of station and associated optional features.
2. Pump performance curves.

3. Maintenance procedures for pump and liquid level controller removal.

4. Level controller data sheets.

5. Pump parts manual and data sheets.

6. Installation and start-up procedures.

7. Electrical JIC system schematics and panel schematics.

PART 2 - PUMP STATION DETAILS

2.01 GENERAL

A. Overview: The lift station shall be a completely factory assembled, weatherproof, watertight, package. The package shall include the liquid storage tank, sump pump, a latching liquid level controller, *and a control panel*. The station provides necessary accessories for a complete operating unit with single point electrical power connections. The station shall contain the manufacturer's label containing the station's part number, indicating the manufacturing date, station's voltage, station's current, liquid level controller set points. Additional features are to be included as under major components.

B. The pump station shall be manufactured by Various Technologies Incorporated, 2720 Aiello Drive, San Jose, California 95111. Part number PS-1__-____.

C. Operation: The primary function of the lift station is to collect the liquid below drainage grade and pump the liquid up to an above ground system. This system operates automatically by making use of the liquid level controller containing a high and a low latching set point *as well as a high high alarm switch*. The high latching set point is used to turn the pump on. The low latching set point is used to turn the pump off. As the liquid level reaches the high latching point, the float, containing specially oriented magnets, trips the latching liquid level controller, turning the pump ON. As the pump empties the tank, the float lowers on the column until reaching the low latching set point, which turns the pump OFF. *The alarm will activate when the liquid level raises the float to the high level alarm set point. The switch will remain activated due to a stop ring pinning the float at this point. Hence, the alarm switch will trigger when the liquid level is at or above this point.*

SIMPLEX SINGLE CONTAINMENT PUMP STATION SAMPLE SPEC PS1VTI
WASTEWATER LIFT STATION - SECTION 1 -

2.02 MAJOR COMPONENTS

A. Tank: The lift station tank shall be constructed of white polypropylene with welded joints. The tank walls shall be manufactured out of 1/2" thick material. *External support steel ribbing encapsulated in polypropylene or internal integral strainer support shall be provided on tanks deeper than 20" and with sides longer than 36"*. The tank shall include an internal flow turbulence damper designed to prevent incoming liquid from aerating and causing pump impeller cavitation. Inlets will be 2" threaded polypropylene fittings welded on the inside and outside of the tank wall. *To facilitates floor anchoring an additional plate will be added to the bottom of tank and extend out from the base of the secondary tank by 2" on each side.*

O.D. base dimensions of the tank shall be __" x __" x __".

The total tank volume is ____ U.S. gallons. Flanges will extend out from the O.D. base dimensions by 2" on each side.

The tank cover and pump mounting plate shall be constructed to allow for removal of the entire pump assembly. The tank cover shall be fastened to the tank with 304 stainless steel bolts and nuts. The pump platform and all other fasteners that are tapped into the cover, and penetrate into the tank cavity, shall be 316 stainless steel bolts. The cover shall be wet set silicone sealed to insure water tight seal. The pump platform and the liquid level controller shall be sealed to the tank cover via an O-ring seal. Discharge piping penetrations on the pump platform shall be made with compression bushing that allows for quick removal of the pump while maintain watertight integrity. A 1-1/2" vent will be FNPT tapped into the tank cover and a 1-1/2" thread by thread street elbow provided. All fittings with threaded connections will be silicone sealed during the manufacturing of the station.

B. Pump: The pump shall be of a seal-less design (such as a Filter Pump Industries Penguin P or HP series pumps) or equal. The pump is to be mounted vertically. The pump shall have a PVC spring suction check valve, *CPVC weighted flapper suction check valve, polypropylene ball suction check valve, or PVDF ball suction check valve*, on tanks with a depth of 18" and deeper. The pump shall have a PVC diaphragm discharge check valve, *CPVC weighted flapper discharge check valve, polypropylene ball discharge check valve, or PVDF ball discharge check valve, with Viton, EP, or Buna*, trim and discharge check valve. The pump piping and fittings shall match the check valve body material specified above. Penetrations of the pump discharge pipe shall be compression bushing sealed to the mounting plate as to achieve a watertight seal. Pump motor shall be epoxy coated TEFC with drip cover. Pump wet ends shall be CPVC, *natural unfilled Polypropylene, or PVDF*.

Pump shall be capable of __ GPM at __ TDH.

SIMPLEX SINGLE CONTAINMENT PUMP STATION SAMPLE SPEC PS1VTI
WASTEWATER LIFT STATION - SECTION 1 -

Pump size and voltage ___hp ___VAC ___ phase 60hz.

C. Liquid Level Control: The controller shall include the following features; all plastic construction. The wet ends shall be polypropylene *or PVDF* material, power interrupt pump down reset, pump down ground default interrupt, latching control for the pump circuit, *an electrically independent alarm high level switch capable of switch a 12Va load as provide on the LC-91 (a redundant high level switch float as provided on the (LC-92) for alarm switch, PVC/EP O-ring sealed mounting flange. Set points to be located for the alarm switch to be at 2" (or ___") from the top of the tank. The pump "ON" set point to be located 2" ,5" (or ___") from the top of the tank. The pump "OFF" set point to be located 3" (or ___") from the bottom of the tank. Various Technologies Inc. Komand-O-Lot™ Part number as follows:*

LC-90P-0G20 with set points of ___H, ___L, ___OVL.

LC-91P-0G20 with set points of ___HH, ___H, ___L, ___OVL.

LC-92P-0G20 with set points of ___HH, ___H, ___L, ___OVL.

LC-90F-0G10 with set points of ___H, ___L, ___OVL.

LC-91F-0G10 with set points of ___HH, ___H, ___L, ___OVL.

LC-92F-0G10 with set points of ___HH, ___H, ___L, ___OVL.

D. Control Panel: The panel enclosure shall be a UL listed NEMA 4X hinged enclosure. The components within the panel must be UL or UR listed and shall be built to conform to the National Electrical Codes (N.E.C.). Factory color coded wires, and labeled terminal bars as to allow for single point electrical connections to house power. All connections to the panel and conduit must conform to Nema 4 and N.E.C. standards. The panel shall contain a motor starter that consists of a thermal overload relay with bimetallic heaters matched to the pump motor load. The motor contactor shall be a heavy duty hermetically seal mercury displacement type relay with maximum motor rating published on the relay housing. The relay shall not require contact replacements.

Circuit breakers, fusing, and or safety disconnect switch for the pump station will be provided by the contractor to meet local, state, and national building codes.

The panel will be station mounted to the pump mounting bracket. All connection to the station from the control panel will be made at the factory and tested as specified herein. *The panel will be remote mounted. The manufacture will test the panel and pump station as a single unit, but will not make conduit penetration into the enclosure. The contractor will be responsible for making these connections after locating the panel remotely.*

Panel Options (all optional lights and switches will contain acid etched engraved integral name plates)

- 1. Provide high level alarm light*

SIMPLEX SINGLE CONTAINMENT PUMP STATION SAMPLE SPEC PS1VTI
WASTEWATER LIFT STATION - SECTION 1 -

- 2. Provide high level alarm light with 83 db pulsing audible alarm.*
- 3. Provide high level alarm light with 83 db pulsing audible alarm and alarm silence button.*
- 4. Provide pump running light*
- 5. Provide dry normally open contacts for high liquid level alarm for external redundant monitoring.*
- 6. Provide Hand-Off-Auto(HOA) switch for manual control of the pump. Hand position turns the pump "ON". Off position shuts the pump "OFF". Auto position allows the liquid level controller to operate the pump automatically.*
- 7. Provide Main Safety disconnect Switch with fusing will be built into the control panel.*
- 8. Provide a fused step down control transform to provide 120 Vac power from the 460/480 Vac panel supply.*

Note: This is a sample specification. Contact Various Technologies Incorporated System Division or your local distributor if you require further customization.